


PLAN VIEW

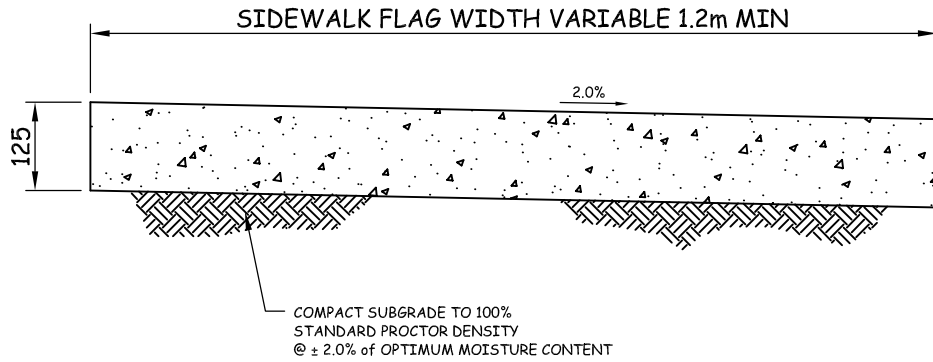

SECTION

NOTES:

1. CONCRETE TO BE TYPE 50, 25 Mpa, 5%-8% AIR, WITH 300kg/m³ CEMENT. TO A MAX OF 360 kg/m³ OF CEMENTATIOUS MATERIAL
2. ALL DIMENSIONS ARE IN MILLIMETRES.
3. REINFORCING BARS SHALL BE CSA 6.30.12 Fy = 400 Mpa

Authorized

Signature

Date

FILE: DRAWING1.DWG LAYOUT RD-202



Medicine Hat
The Gas City

Municipal Servicing Standard

SEPERATE SIDEWALK,

DWG NO.
RD-303