




### MONOLITHIC SIDEWALK SECTION

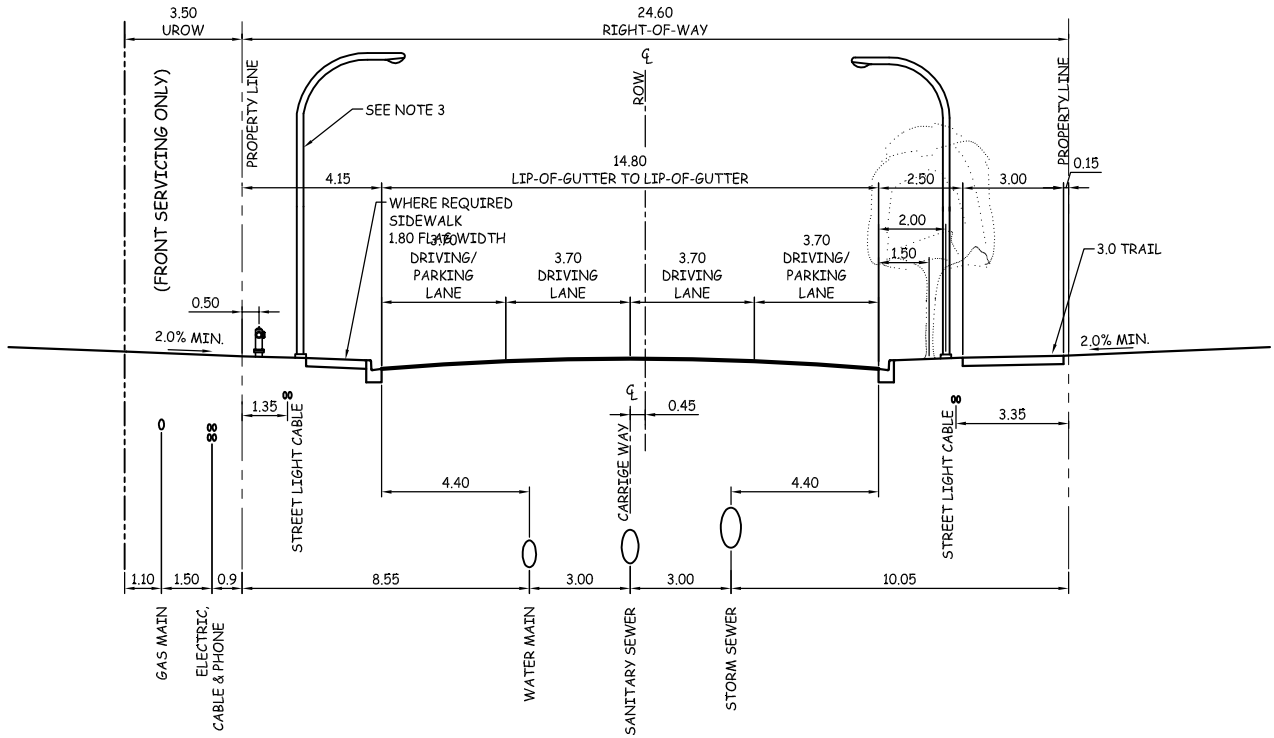

### SEPARATE SIDEWALK (ALTERNATE) SECTION

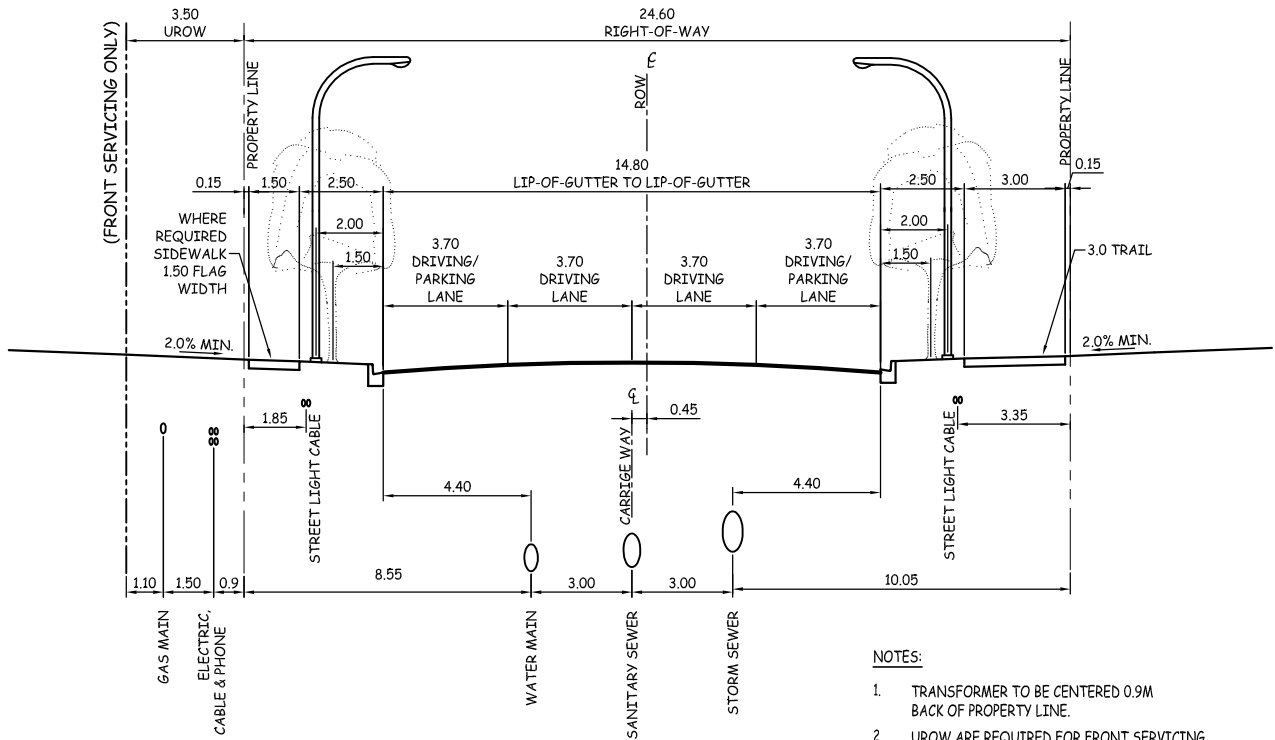

#### MINIMUM ROAD STRUCTURE

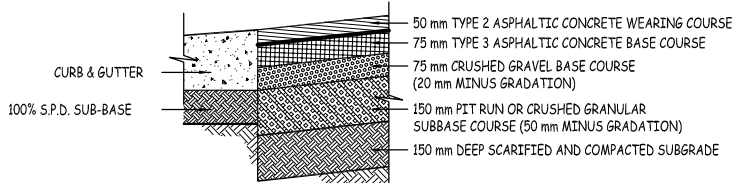

#### NOTES:

1. TRANSFORMER TO BE CENTERED 0.9M BACK OF PROPERTY LINE.
2. UROW ARE REQUIRED FOR FRONT SERVICING.
3. FOR MONOWALK ONLY- ALIGNMENT OF STREET LIGHT BASES TO BE ADJACENT TO BACK OF WALK OR IN THE ELECTRICAL DISTRIBUTION TRENCH.
4. STREET LIGHT CABLES TO BE LOCATED AS SHOWN OR IN THE ELECTRICAL DISTRIBUTION TRENCH.
5. FOR SEPARATE SIDEWALK ONLY - FIRE HYDRANTS TO BE INSTALLED 1.50 METRES BEHIND LIP-OF-GUTTER (SAME ALIGNMENT AS TREE PLANTING)
6. ALL DIMENSTONS IN METRES, UNLESS OTHERWISE NOTED.

Authorized \_\_\_\_\_

Signature \_\_\_\_\_

Date \_\_\_\_\_

FILE: ROAD SECTIONS.DWG LAYOUT RD-110



**Medicine Hat  
The Gas City**

Municipal Servicing Standard

**MAJOR COLLECTOR ROADWAY  
(24.6m ROW - 14.8m TW)  
INDUSTRIAL/COMMERCIAL AREAS**

DWG NO. RD-107