




MONOLITHIC SIDEWALK SECTION

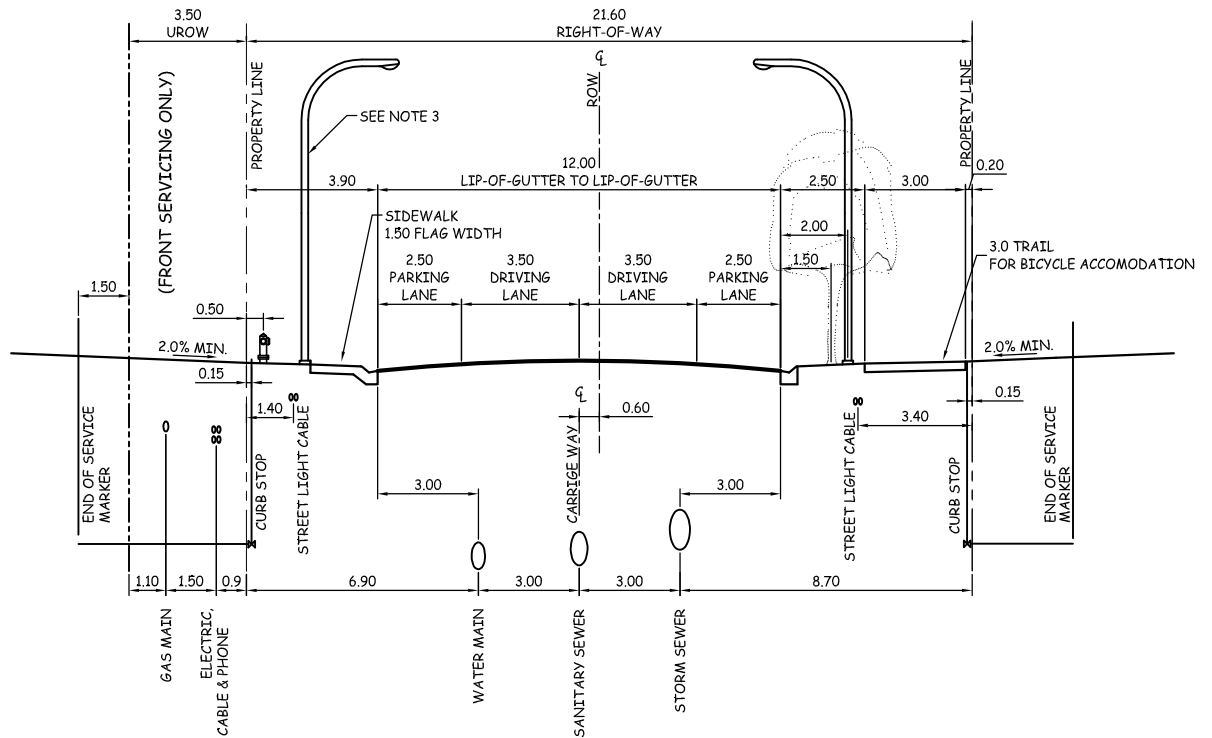

SEPARATE SIDEWALK (ALTERNATE) SECTION

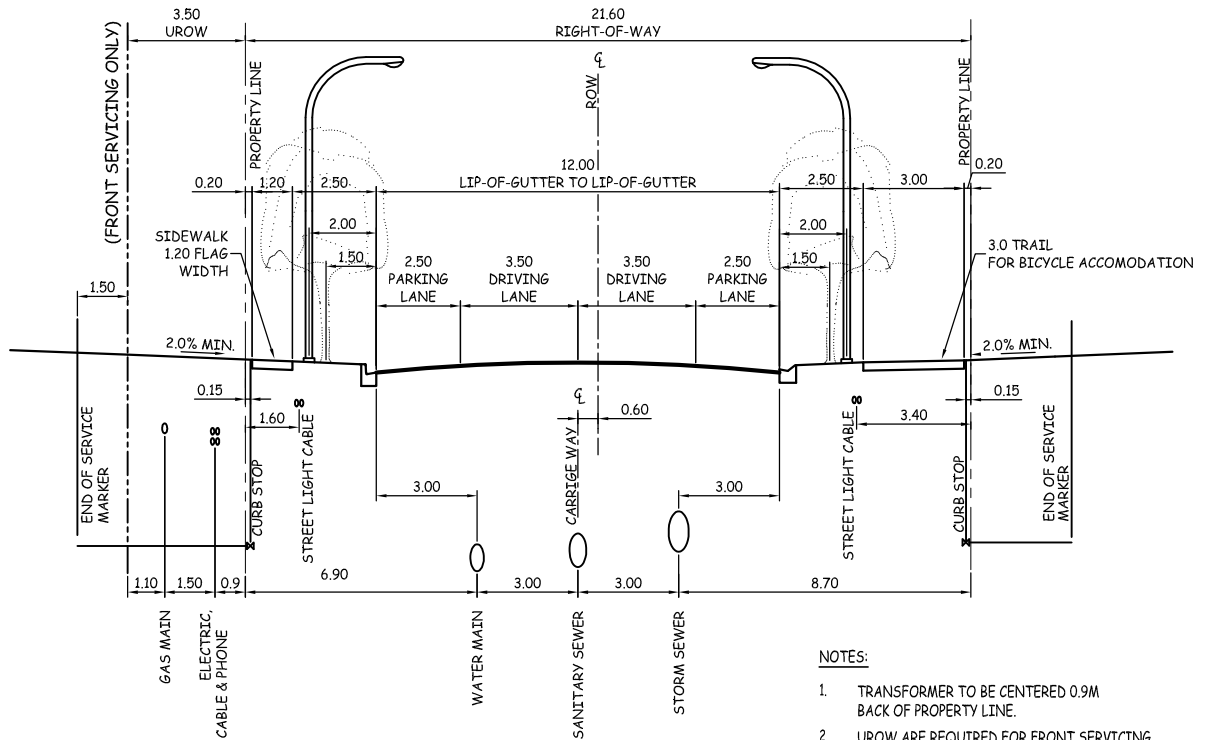

MINIMUM ROAD STRUCTURE

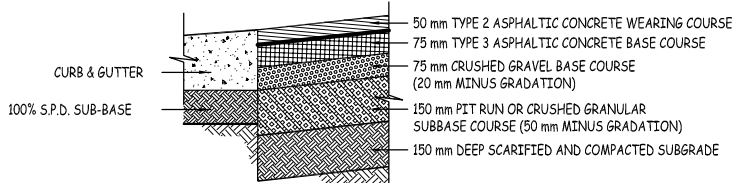

NOTES:

1. TRANSFORMER TO BE CENTERED 0.9M BACK OF PROPERTY LINE.
2. UROW ARE REQUIRED FOR FRONT SERVICING.
3. FOR MONOWALK ONLY- ALIGNMENT OF STREET LIGHT BASES TO BE ADJACENT TO BACK OF WALK OR IN THE ELECTRICAL DISTRIBUTION TRENCH.
4. STREET LIGHT CABLES TO BE LOCATED AS SHOWN OR IN THE ELECTRICAL DISTRIBUTION TRENCH.
5. FOR SEPARATE SIDEWALK ONLY - FIRE HYDRANTS TO BE INSTALLED 1.50 METRES BEHIND LIP-OF-GUTTER (SAME ALIGNMENT AS TREE PLANTING)
6. ALL DIMENSTONS IN METRES, UNLESS OTHERWISE NOTED.

Authorized

Signature

Date

FILE: ROAD SECTIONS.DWG LAYOUT RD-113



**Medicine Hat
The Gas City**

Municipal Servicing Standard

**RESIDENTIAL MINOR COLLECTOR
ROADWAY
(21.6m ROW - 12.0m TW)**

RD-110
DWG NO.