


GAS METER SET PLACEMENT

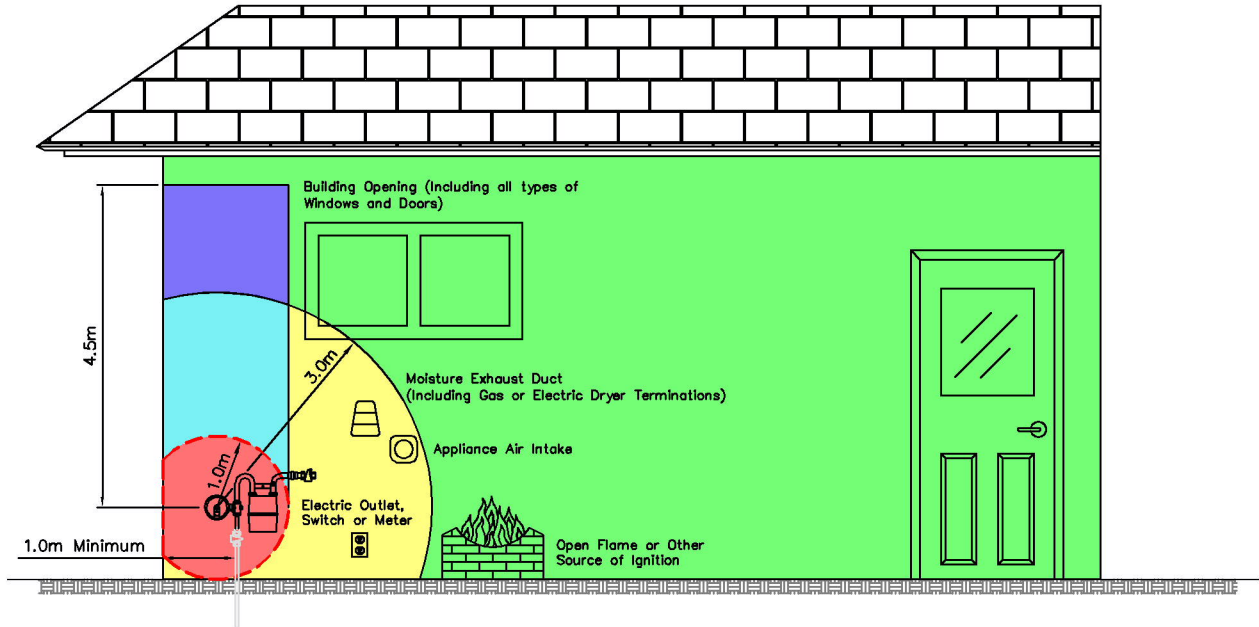

- ALL ITEMS PROHIBITED
- MECHANICAL AIR INTAKE PROHIBITED
- MOISTURE EXHAUST DUCT PROHIBITED
- ALL ITEMS ALLOWED (WHERE SPACE IS AVAILABLE)

ITEM	ALLOWED IN:				PROHIBITED IN:			
Building Openings	Green	Yellow	Light Blue	Dark Blue	Red			
Appliance Vent Outlet	Green	Yellow	Light Blue	Dark Blue	Red			
* Moisture Exhaust Duct	Green	Yellow	Light Blue	Dark Blue	Red	Light Blue	Dark Blue	
Appliance Air Intake	Green	Yellow	Light Blue	Dark Blue	Red			
Source of Ignition	Green	Yellow	Light Blue	Dark Blue	Red			
Fire Escapes	Green	Yellow	Light Blue	Dark Blue	Red			
Mechanical Air Intake	Green				Red	Yellow	Light Blue	Dark Blue
All Gas Appliance Vents	Green	Yellow			Red	Light Blue	Dark Blue	

*Moisture Exhaust Ducts are prohibited in the 4.5m blue zones above the regulator. They are also prohibited in the yellow and green zones directly above the meter.

Note: Spacing is based on use of typical Regulators that are without ANSI Z21.80/CSA 6.22 Certified Overpressure Protection Device

DRAWN BB ORIGINATOR . CHECKED . APPROVED . DATE SEPT. 28, 2016		City of Medicine Hat Gas Distribution RESIDENTIAL GAS METER SET PLACEMENT USING ALL REGULATORS (EXCEPT BRYAN DONKIN)		SCALE NTS FILE NO. . ACCOUNT NO. . DRAWING NO. G-STD-D-091-A4
-------------------------------------------------------------------------------------------	--	--------------------------------------------------------------------------------------------------------------------------------------	--	------------------------------------------------------------------------------------