City of Medicine Hat
Cross Connection Control Program
Temporary Water Service

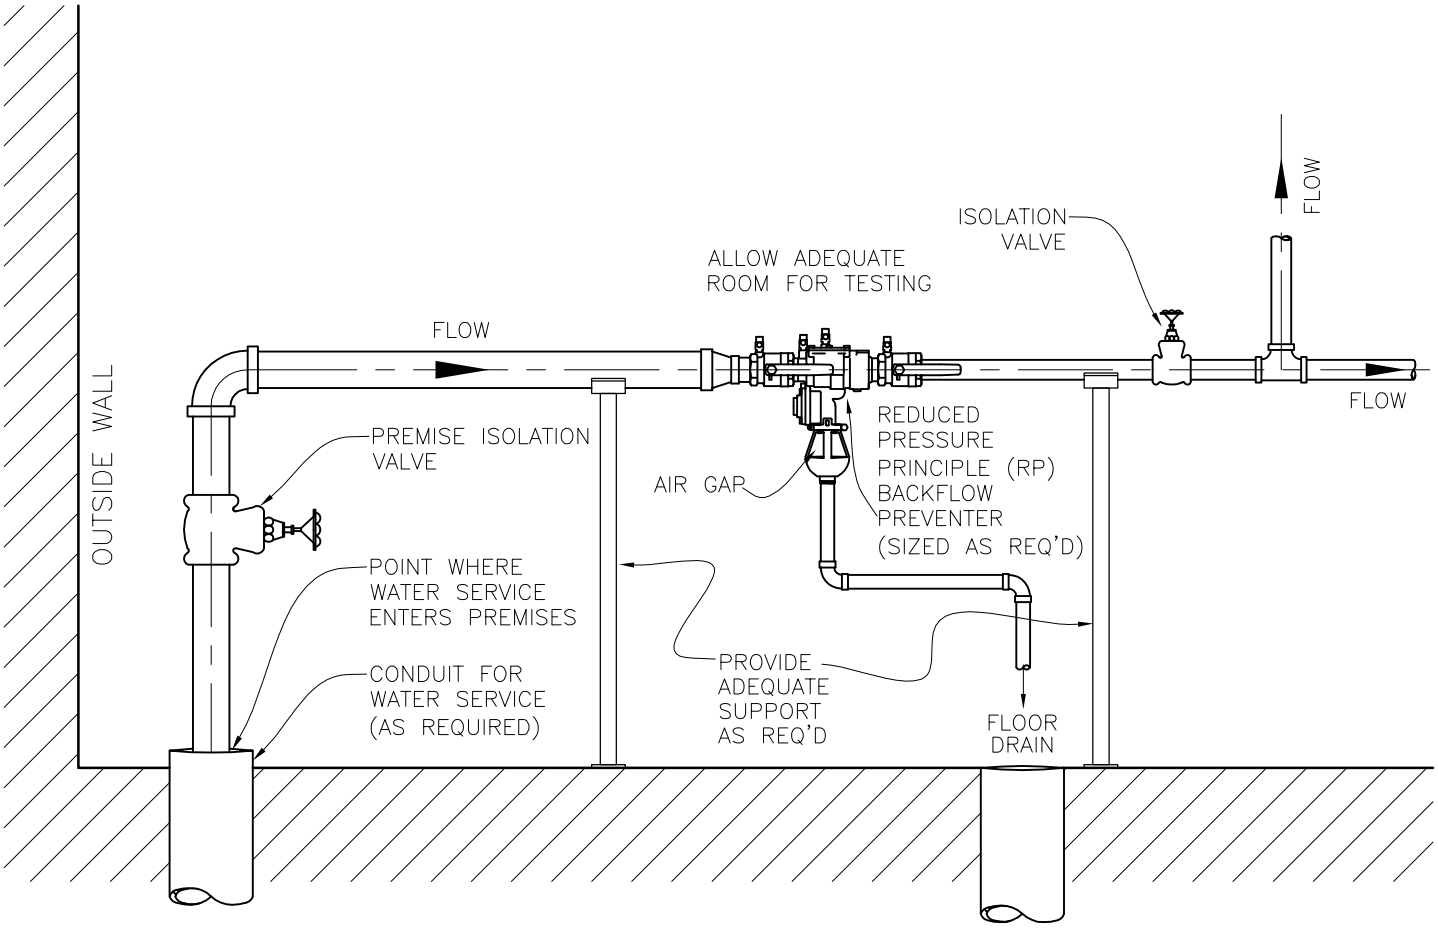

NOTE:

1. REDUCED PRESSURE PRINCIPLE DEVICE ONLY, UNLESS OTHERWISE SPECIFIED BY ENVIRONMENTAL UTILITIES CROSS CONNECTION OFFICER
1. THERE SHALL BE NO TAPS, TAKE-OFFS OR TIE-INS TO THE SERVICE PLUMBING UPSTREAM OF THE BACKFLOW PREVENTER.
2. THERE SHALL BE NO BYPASSES AROUND THE BACKFLOW PREVENTER UNLESS THE BYPASS IS FITTED WITH A BFP OF THE SAME TYPE.

AUTHORITY: BYLAW 2379 CLAUSE 28

No.	DATE (YY MM DD)	REVISION DESCRIPTION	BY	APP'D

DATE: 17/09/21
SCALE: N.T.S.
DRAWN: JED
APPROVED: GD

Medicine Hat
The Gas City
Environmental Utilities

TEMPORARY WATER SERVICE
CROSS CONNECTION
CONTROL PROGRAM

DWG. No. EU-222