City of Medicine Hat
Cross Connection Control Program
Premises Isolation

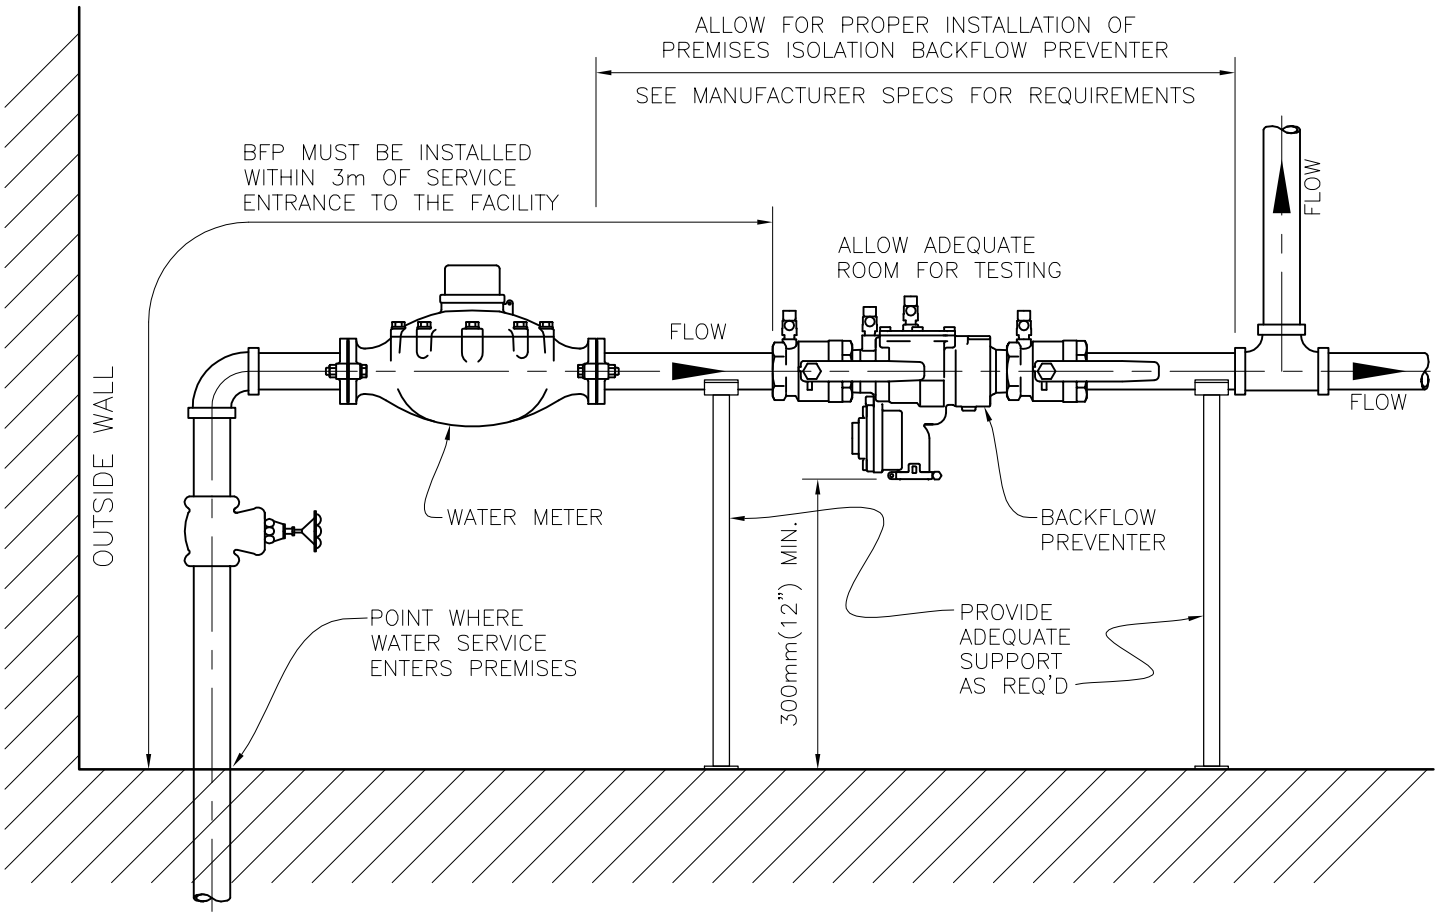

NOTE:

1. REFER TO CSA B64–10 FOR SELECTION OF BACKFLOW PREVENTION DEVICE.
2. THERE SHALL BE NO TAPS, TAKE–OFFS OR TIE–INS TO THE SERVICE PLUMBING UPSTREAM OF THE BACKFLOW PREVENTER.
3. THERE SHALL BE NO BYPASSES AROUND THE BACKFLOW PREVENTER UNLESS THE BYPASS IS FITTED WITH A BFP OF THE SAME TYPE.

AUTHORITY: BYLAW 2379 CLAUSE 28

No.	DATE YY	MM	DD	REVISION DESCRIPTION	BY	APP'D
4	16	03	18	ADDED REFER TO CSA B64–10 NOTE	JED	
3	15	08	28	CORRECTED PREMISES ISOLATION NOTE	CGK	
2	02	06	07	CHANGED MIN. CLEARANCE TO 12 IN.	CGK	
1	02	03	22	CHANGED DWG NUMBER FROM EU–214	CGK	

DATE: 01/12/03
SCALE: 1:10
DRAWN: C.G.K.
APPROVED: SIEWAL. MAK.

Medicine Hat
The Gas City
Environmental Utilities

PREMISE ISOLATION DETAILS
CROSS CONNECTION
CONTROL PROGRAM

DWG. No. EU–215