



(B) INTERIOR  
METER INSTALLATIONS  
FOR METER SIZES 50mm AND SMALLER

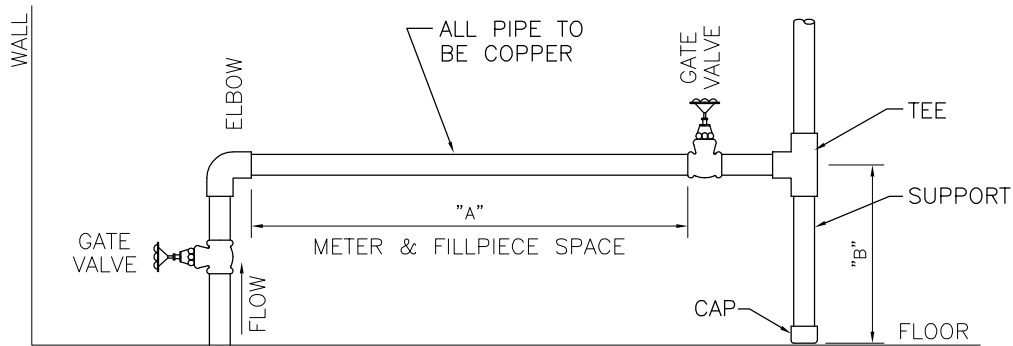

SIZE	"A"	"B" MAX	"B" MIN
15mm	400mm	300mm	300mm
20mm	450mm	300mm	300mm
25mm	550mm	300mm	300mm
40mm	550mm	300mm	300mm

1. MINIMUM DISTANCE OF  $\varnothing$  OF PIPING ADJACENT TO METER SETTING TO BE 300mm FROM ANY ENTRANCE WALL OR INSIDE WALL.
2. VALVE REQUIRED ON OUTLET SIDE OF METER SETTING ON PIPING 25mm AND OVER VALVE OPTIONAL ON PIPING UNDER 25mm
3. PIPING FOR "A" MUST BE IN A HORIZONTAL PLANE

						DATE: 82/08/04	 <b>Medicine Hat</b> The Gas City Environmental Utilities	<b>METER SETTING SPECIFICATIONS</b>
4	10	12	22			SCALE: N.T.S.		
3	06	09	21			DRAWN:		
2	02	03	22	CHANGED DWG NUMBER FROM EU-207	CGK			
1	01	01	23	HYBRID, GENERAL REVISION	CGK			
No.	YY	MM	DD	REVISION DESCRIPTION	BY	APP'D	APPROVED: M.J. SIEWAL, MAK	DWG. No. EU-210